

# SERIES BREZZA





NEW
WATER CASSETTE





### **CONTENTS**

1-INTRODUCTION	4
2-APPLICATION LIMITS	4
3-THE COANDA EFFECT – (MPKC) – (MPKD) PANELS	5
4-CODES INTERPRETATION KEY	7
5-TECHNICAL SPECIFICATIONS	8
6 - TECHNICAL DATA (AC motors)	10
6.1-Unit with 3-row coil	10
7-TECHNICAL DATA (EC motor)	13
7.1- Unit with 3-row coil	13
9-ACCESSORIES	17
9.1-Valves (V) and auxiliary tray (ADPB)	
9.2-Auxiliary condensate drain pump (PSCC-BI)	19
9.3-Flange for ducted air delivery (FLMA)	20
9.4-Flange for outdoor air intake (FLAE)	20
9.5 - Metal cover for exposed installation (MECO)	21
9.6-Filter with Sanitized treatment (FA/SAN)	23
9.7-High efficiency filter (FA/H)	23
9.8-Electrical heater (EH)	23
10-Hygienic version	24
11-Electrical connections	25
11.1-Wiring diagram of cassette with AC motor	25
11.2-Wiring diagram of cassette with EC motor	26

#### 1-INTRODUCTION

BREZZA series units are designed for air conditioning in the residential and commercial sector, for indoor installation in areas not exposed to freezing conditions or extreme temperatures and in a dust-free, non-explosive atmosphere. The manufacturer cannot be held liable for the consequences of incorrect use of the unit.

The BREZZA series is available both with traditional three-speed AC motors and with low consumption EC motors. The table below highlights the electricity savings that can be achieved with the EC motors (at the same machine operating points).

### 2-APPLICATION LIMITS

Electrical power supply	220 – 240V / 50Hz
Coil inlet water temperature	5 / 70°C
Return air temperature	12 / 50°C
Return air relative humidity	15 / 70%

The unit should only operate close to limit use values for short periods of time because operation close to limit conditions for prolonged periods can reduce the normal lifetime of unit components.

#### N.B. Regulation speed of the EC motor


It is suggested to operate with a minimum signal of at least 2 V (or more) for EC motors to avoid any interference on the appliance deriving from the external environment (electromagnetic field, microwaves, flicker, etc...)




### 3-THE COANDA EFFECT - (MPKC) - (MPKD) PANELS

The BREZZA series units are designed to ensure high levels of comfort. Annoying cold air draughts (usually the problem with cassette fan-coils) are avoided by the special shaping of the panel, which lets air into the environment with a COANDA effect.

The COANDA effect is the tendency of a jet of fluid to follow the outline of a nearby surface. Therefore the air flow follows the ceiling line, and then falls back on to the walls. Since at this point the air speed is very low, it will not cause any discomfort to people.







Traditional cassette

Cassette with Coanda effect MPKC panel

If the ceiling height exceeds 3m and therefore it is necessary to direct the air flow downwards, a panel with adjustable fins is available as an accessory. In this way it is possible to manually adjust the flow orientation for each one of the four deliveries: horizontal (with coanda effect), vertical or in an intermediate position.

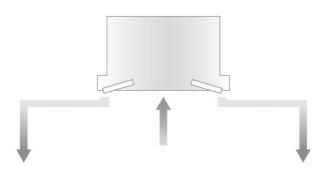


Cassettes with MPKD panel Fins in horizontal position (coanda)

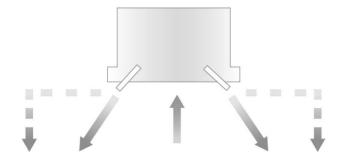


Cassettes with MPKD panel Fins in vertical position

The panel constitutes a separate ordering code by the cassette and is available in the following versions:


**MPKC** Fixed fins round holes




**MPKD** adjustable fins round holes




MPKC S128 Fixed fins squared holes



MPKD S128 adjustable fins squared holes



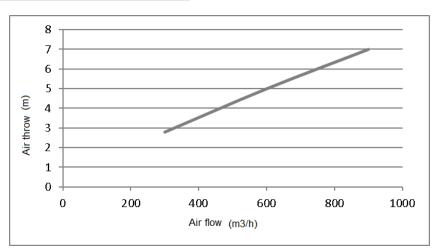


CAUTION! The difference in temperature between the delivery air and the ambient air can significantly influence the air throw.



#### 4-CODES INTERPRETATION KEY

The standard version has a 3-row coil (for 2-pipe versions) or 1 plus 2-row coil (for 4-pipe versions), with fixed fins in the coanda position. All others are optional versions.

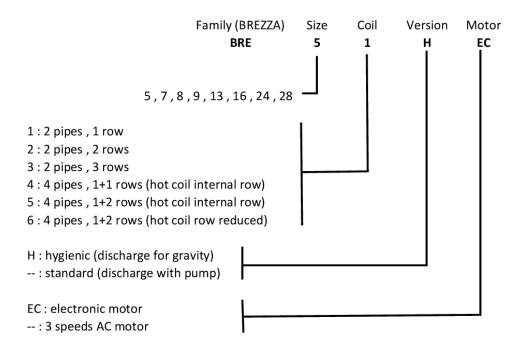

#### 5-TECHNICAL SPECIFICATIONS

**FRAME**: made of 1.00 mm thick galvanized sheet steel. This rugged structure prevents the propagation of vibration and comes complete with ceiling fixing brackets.

**FRONT PANEL:** made of 0.8mm thick painted RAL9003 metal plate. The shape of the baffles results in a coanda effect on the output air flow. As an accessory option, it is possible to have adjustable baffles to obtain a coanda effect or vertical air flow (or intermediate positions). The stylish design of the panel integrates perfectly into any environment and type of false ceiling.



N.B. The FRONT PANEL is intended as an accessory to be ordered additionally.

**ACCESSIBILITY:** the filter can be removed without having to use tools. Accessibility to internal components (fan and condensate drain pump) is guaranteed by removing the front panel. The hydraulic connections, the valves and the electrical panel are on the same side and therefore, only one inspection hatch must be made in the false ceiling.

FILTER: class G1 (EN779), thickness 6mm, made of polypropylene mesh.

**FAN UNIT:** backward curved blade fan wheels directly coupled to the motor. The fan is made of reinforced plastic (PA6-25GF nylon). The motor and fans are balanced after assembly to ensure vibration free operation. The motor runs on maintenance-free ball bearings.

The AC motor has three speeds, degree of protection IP44, insulation class "B". Built-in thermal cutout.

The EC motor has 0-10V control, protection rating IP54, insulation class "B", emission of disturbances in compliance with EN 61000-6-3 (civil environment), motor and electronics overload cutout, locked rotor protection.

**COIL**: made of diameter 3/8" copper tubing with high efficiency corrugated aluminium fins; manual air bleed valve at the top. Nominal pressure PN10.


**CONDENSATE COLLECTION TRAY:** air conveyor made of foamed polystyrene (PPE) with moulded plastic condensate collection tray, which prevents water leaks even after prolonged use. Drip tray shaped to facilitate run-off, minimising standing water.

**INSULATION**: cassette body insulated with 10mm thick cross-linked polyethylene foam, class B-s2d0 BL-s1d0 according to the EN13501-1 standard. Front panel insulated with 3mm thick polyethylene.



**ELECTRICAL CONTROL PANEL**: made of galvanized sheet steel positioned on the same side as the hydraulic connections.

**CONDENSATE DRAIN PUMP:** centrifugal type, equipped with double level float (alarm and pump on-off) and check valve (to prevent the return of foul smells from the drain and reduce noise on power-on). The maximum head of the pump is 650mm, measured from the edge of the panel.

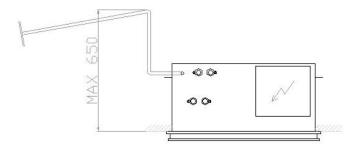

### 6 - TECHNICAL DATA (AC motors)

This chapter lists the operating specifications of the units with 3-row main coils and 1-row auxiliary coils. The main 1- and 2-row coils are also available from our selection software.

#### 6.1-Unit with 3-row coil

EUROVENT

PERFORMANCE													
www.eurovent-certification.com		I					2 PI	PES					
www.certiflash.com			53			73			83			93	
Speed(E)		min	med	max	min	med	max	min	med	max	min	med	max
Air flow rate	mc/h	290	380	550	350	500	710	410	560	770	540	790	920
COOLING - air 27 °C (dry	bulb) ,	19 °C v	v.b w	ater in	et 7 °C	, outle	12 °C		l .		•		
Total capacity (E)	kW	2,25	2,79	3,71	2,62	3,45	4,47	2,97	3,76	4,74	3,66	4,82	5,36
Sensitive capacity (E)	kW	1,58	1,99	2,70	1,86	2,50	3,30	2,12	2,74	3,52	2,66	3,59	4,03
Water flow rate	l/h	387	480	638	450	594	769	510	647	814	629	829	921
Δp (water) (E)	kPa	4,3	6,3	10,3	5,6	9,1	14,3	7,0	10,6	18,0	10,1	16,4	23,0
HEATING - air 20 °C - wa	ter inlet	45 °C,	outlet	40 °C		l	1		ı	l		l	
Capacity (E)	kW	2,17	2,75	3,78	2,56	3,49	4,62	2,94	3,84	4,93	3,72	5,03	5,67
Water flow rate	l/h	375	476	654	443	604	799	509	664	853	644	870	980
Δp (water) (E)	kPa	3,4	5,1	8,9	4,5	7,8	12,7	5,7	9,2	19,0	8,7	14,7	23,0
MOTOR ELECTRIC POW	ER DRA	W	ı	ı		l	1		ı	l		l	
Power draw (E)	W	25	30	40	30	36	50	41	50	64	54	72	87
Max power draw	Α		0,18	·		0,23			0,29			0,40	
SOUND DATA	•	•									-		
Sound power (E)	dB(A)	35	39	48	39	46	55	40	48	57	49	59	62
Sound pressure (*)	dB(A)	26	30	39	30	37	46	31	39	48	40	50	53

<sup>(</sup>E) = EUROVENT certified performance.

<sup>(\*) =</sup> the sound pressure levels are lower than power levels by 9 dB(A) for a 100 m3 space and a reverberation time of 0.5 sec.



PERFORMANCE www.eurovent-certification.com		4 PIPES							
www.eurovent-certification.com www.certiflash.com			75		95				
Speed(E)		min	med	max	min	med	max		
Air flow rate	mc/h	350	500	710	540	790	920		
COOLING - air 27 °C (dry bulb) , 19	°C w.b water inle	et 7 °C, out	let 12 °C				1		
Total capacity (E)	kW	2,20	2,81	3,56	2,96	3,81	4,19		
Sensitive capacity (E)	kW	1,60	2,10	2,73	2,23	2,94	3,28		
Water flow rate	l/h	375	483	612	509	655	721		
Δp (water) (E)	kPa	6,2	9,7	14,6	10,6	16,5	19,5		
HEATING - air 20 °C - water inlet 65	5°C, outlet 55°C								
	•								
Capacity (E)	kW	2,83	3,62	4,61	3,82	4,95	5,47		
Capacity (E) Water flow rate		2,83 243	3,62 312	4,61 397	3,82 328	4,95 425	5,47 471		
Water flow rate	kW		,	,		,	,		
Water flow rate Δp (water) (E)	kW I/h kPa	243	312	397	328	425	471		
Water flow rate Δp (water) (E)  MOTOR ELECTRIC POWER DRAW	kW I/h kPa	243	312	397	328	425	471		
	kW I/h kPa	243	312 8,1	397	328 8,9	425	471		
Water flow rate Δp (water) (E)  MOTOR ELECTRIC POWER DRAW  Power draw (E)	kW I/h kPa	243	312 8,1 36	397	328 8,9	425 14,0	471		
Water flow rate  \( \Delta \) (water) (E)  MOTOR ELECTRIC POWER DRAW  Power draw (E)  Max power draw	kW I/h kPa	243	312 8,1 36	397	328 8,9	425 14,0	471		

<sup>(</sup>E) = EUROVENT certified performance.

<sup>(\*) =</sup> the sound pressure levels are lower than power levels by 9 dB(A) for a 100 m3 space and a reverberation time of 0.5 sec.

#### **Sound leves**

	0				S	ound pow	er				Sound	
	Speed [V]	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	TOT	ALE	pressure	NR
	[ v ]	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)	dB(A)	
BRE	Min	42,2	39,8	33,1	25,6	15,5	12,2	16,3	44,6	35,0	26,0	20
53	Med	43,6	43,4	37,4	31,5	23,8	12,3	12,8	47,1	39,0	30,0	24
33	Max	49,6	50,7	46,8	42,1	35,8	25,4	15,0	54,4	48,0	39,0	34
סחר	Min	46,2	43,8	37,1	29,6	19,5	16,2	20,3	48,6	39,0	30,0	24
BRE 73/75	Med	50,6	50,4	44,4	38,5	30,8	19,3	19,8	54,1	46,0	37,0	32
13/13	Max	56,6	57,7	53,8	49,1	42,8	32,4	22,0	61,4	55,0	46,0	41
פטר	Min	47,2	44,8	38,1	30,6	20,5	17,2	21,3	49,6	40,0	31,0	25
BRE 83	Med	52,6	52,4	46,4	40,5	32,8	21,3	21,8	56,1	48,0	39,0	34
03	Max	58,6	59,7	55,8	51,1	44,8	34,4	24,0	63,4	57,0	48,0	43
BRE	Min	54,0	53,6	47,2	41,3	33,4	22,1	21,7	57,4	49,0	40,0	35
93/95	Med	60,8	61,3	58,1	53,0	46,7	37,9	26,5	65,4	59,0	50,0	45
33/33	Max	63,7	63,0	60,9	57,0	50,5	43,5	32,3	67,9	62,0	53,0	48

NR values calculated considering a difference of 9 dB between sound power and sound pressure for a room of 100 m3 and a reverberation time of 0.5 sec. The db(A) data declared in the technical table of the manual was obtained from the sum of the db(A) relating to all the octave bands and not only to the central one. The value may therefore differ slightly from those deriving from the above data for purely mathematical reasons.



### 7-TECHNICAL DATA (EC motor)

This chapter lists the operating specifications of the units with 3-row main coils and 1-row auxiliary coils. The main 1- and 2-row coils are also available from our selection software.

#### 7.1- Unit with 3-row coil

	2 PIPES										
			73			93					
	2V	4,7V(E)	6,6V(E)	9,8V(E)	10V	2V	4,0 <mark>(E)</mark>	6,4 <mark>(E)</mark>	8,8 <mark>(E)</mark>	10V	
mc/h	150	300	450	700	716	150	350	600	835	960	
ry bulb) ,	19 °C w	.b wate	er inlet 7 °	C, outlet	12 °C				•		
kW	1,18	2,25	3,11	4,32	4,4	1,16	2,55	3,86	4,88	5,41	
kW	0,82	1,59	2,23	3,19	3,24	0,81	1,81	2,82	3,65	4,03	
l/h	203	397	548	761	754	199	450	680	862	928	
kPa	1,4	4,5	7,9	14,1	14,6	1,4	5,6	11,6	17,5	21	
ater inle	45 °C, 0	outlet 40	°C								
kW	1,16	2,17	3,11	4,46	4,54	1,16	2,50	3,93	5,12	5,71	
l/h	208	387	552	790	820	208	443	697	909	1033	
kPa	1,3	3,5	6,6	12,4	12,8	1,2	4,5	10,0	15,9	19,4	
WER DR	AW										
W	2	3	8	22	23	2	5	15	48	63	
Α			0,17					0,38			
dB(A)	28	32	42	53	54	28	37	50	59	65	
dB(A)	19	23	33	44	45	19	28	41	50	56	
ION											
A A											
			Α					Α			
	ry bulb) , kW kW l/h kPa rater inlet kW l/h kPa WER DRA W A  dB(A) dB(A)	mc/h 150 ry bulb) , 19 °C w kW 1,18 kW 0,82 I/h 203 kPa 1,4 rater inlet 45 °C, 6 kW 1,16 I/h 208 kPa 1,3 WER DRAW W 2 A  dB(A) 28 dB(A) 19	mc/h 150 300  ry bulb) , 19 °C w.b water kW 1,18 2,25 kW 0,82 1,59 l/h 203 397 kPa 1,4 4,5 rater inlet 45 °C, outlet 40 kW 1,16 2,17 l/h 208 387 kPa 1,3 3,5  WER DRAW  W 2 3 A  dB(A) 28 32 dB(A) 19 23	2V   4,7V(E)   6,6V(E)   mc/h   150   300   450   y bulb) , 19 °C w.b water inlet 7 °C   kW   1,18   2,25   3,11   kW   0,82   1,59   2,23   l/h   203   397   548   kPa   1,4   4,5   7,9   rater inlet 45 °C, outlet 40 °C   kW   1,16   2,17   3,11   l/h   208   387   552   kPa   1,3   3,5   6,6   were detailed with the content of	2V   4,7V(E)   6,6V(E)   9,8V(E)   mc/h   150   300   450   700   ry bulb) , 19 °C w.b water inlet 7 °C, outlet   kW   1,18   2,25   3,11   4,32   kW   0,82   1,59   2,23   3,19   l/h   203   397   548   761   kPa   1,4   4,5   7,9   14,1   rater inlet 45 °C, outlet 40 °C   kW   1,16   2,17   3,11   4,46   l/h   208   387   552   790   kPa   1,3   3,5   6,6   12,4   WER DRAW   W   2   3   8   22   A   0,17     dB(A)   28   32   42   53   dB(A)   19   23   33   44   TION   A	73  2V 4,7V(E) 6,6V(E) 9,8V(E) 10V  mc/h 150 300 450 700 716  ry bulb) , 19 °C w.b water inlet 7 °C, outlet 12 °C  kW 1,18 2,25 3,11 4,32 4,4  kW 0,82 1,59 2,23 3,19 3,24  l/h 203 397 548 761 754  kPa 1,4 4,5 7,9 14,1 14,6  rater inlet 45 °C, outlet 40 °C  kW 1,16 2,17 3,11 4,46 4,54  l/h 208 387 552 790 820  kPa 1,3 3,5 6,6 12,4 12,8  NER DRAW  W 2 3 8 22 23  A 0,17   dB(A) 28 32 42 53 54  dB(A) 19 23 33 44 45  TION	73  2V 4,7V(E) 6,6V(E) 9,8V(E) 10V 2V  mc/h 150 300 450 700 716 150  ry bulb) , 19 °C w.b water inlet 7 °C, outlet 12 °C  kW 1,18 2,25 3,11 4,32 4,4 1,16  kW 0,82 1,59 2,23 3,19 3,24 0,81  l/h 203 397 548 761 754 199  kPa 1,4 4,5 7,9 14,1 14,6 1,4  rater inlet 45 °C, outlet 40 °C  kW 1,16 2,17 3,11 4,46 4,54 1,16  l/h 208 387 552 790 820 208  kPa 1,3 3,5 6,6 12,4 12,8 1,2  NER DRAW  W 2 3 8 22 23 2  A 0,17   dB(A) 28 32 42 53 54 28  dB(A) 19 23 33 44 45 19  rion  A	73  2V 4,7V(E) 6,6V(E) 9,8V(E) 10V 2V 4,0(E) mc/h 150 300 450 700 716 150 350  ry bulb) , 19 °C w.b water inlet 7 °C, outlet 12 °C  kW 1,18 2,25 3,11 4,32 4,4 1,16 2,55  kW 0,82 1,59 2,23 3,19 3,24 0,81 1,81  I/h 203 397 548 761 754 199 450  kPa 1,4 4,5 7,9 14,1 14,6 1,4 5,6  rater inlet 45 °C, outlet 40 °C  kW 1,16 2,17 3,11 4,46 4,54 1,16 2,50  I/h 208 387 552 790 820 208 443  kPa 1,3 3,5 6,6 12,4 12,8 1,2 4,5  WER DRAW  W 2 3 8 22 23 2 5  A 0,17   dB(A) 28 32 42 53 54 28 37  dB(A) 19 23 33 44 45 19 28  TION	T3   93   94   95   95   95   95   95   95   95	T3	

<sup>(</sup>E) = EUROVENT certified performance.

<sup>(\*) =</sup> the sound pressure levels are lower than power levels by 9 dB(A) for a 100 m3 space and a reverberation time of 0.5 sec.

CERTIFIED PERFORMANCE											
www.eurovent-certification.com						4 PIP	ES				
www.eurovent-certification.com www.certiflash.com				75					95		
Speed(E)		2V	4,7V(E)	6,6V(E)	9,8V(E)	10V	2V	4,0(E)	6,4(E)	8,8(E)	10V
Air flow rate	mc/h	150	300	450	700	716	150	350	600	835	960
COOLING - air 27 °C (d	ry bulb) ,	19 °C w	.b wate	er inlet 7 °	C, outlet	12 °C					
Total capacity (E)	kW	0,96	1,90	2,50	3,40	3,45	0,95	2,10	3,10	3,90	4,29
Sensitive capacity (E)	kW	0,72	1,40	1,90	2,60	2,64	0,71	1,60	2,30	3,00	3,29
Water flow rate	l/h	165	327	430	585	592	166	361	533	671	736
Δp (water) (E)	kPa	1,6	5,1	8,4	14,0	14,4	1,6	5,4	12,0	17,9	21,2
HEATING - air 20 °C - v	ater inle	65°C, c	outlet 55°	С							
Capacity (E)	kW	1,48	2,42	3,22	4,49	4,52	1,52	2,76	4,03	5,06	5,50
Water flow rate	l/h	132	208	277	386	390	132	237	346	435	454
Δp (water) (E)	kPa	1,6	5,4	8,8	14,9	14,9	1,8	5,2	10,1	14,9	17,2
MOTOR ELECTRIC PO	WER DR	ΑW									
Power draw (E)	W	2	4	9	26	26	2	5	15	48	63
Max power draw	Α			0,17					0,38		
DATI SONORI											
Sound power (E)	dB(A)	28	32	42	53	54	28	37	50	59	65
Sound pressure (*)	dB(A)	19	23	33	44	45	19	28	41	50	56
CLASSIFICAZIONE EN	ERGETIC	A									
FCEER (E) A A											
FCCOP(E)				Α					Α		

<sup>(</sup>E) = EUROVENT certified performance. (\*) = the sound pressure levels are lower than power levels by 9 dB(A) for a 100 m3 space and a reverberation time of 0.5 sec.





#### Sound levels


	0				Po	tenza son	ora				Sound	
	Speed [V]	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	TOT	ALE	pressure	NR
	[4]	dB	dB	dB	dB	dB	dB	dB	dB	dB(A)	dB(A)	
	2V	37,7	32,4	22,9	17,2	8,7	12,3	18,0	39,0	28,0	19	16
	3V	38,8	33,5	24,0	18,3	9,8	13,4	19,1	40,1	29,0	20,0	17
	4V	39,8	34,5	25,0	19,3	10,8	14,4	20,1	41,1	30,0	21,0	18
BRE	5V	44,0	40,7	32,2	26,0	15,2	11,5	16,8	45,9	35,5	26,5	21
73/75	6V	47,5	44,2	35,7	29,5	18,7	15,0	20,3	49,4	39,0	30,0	25
EC	7V	52,0	48,7	40,2	34,0	23,2	19,5	24,8	53,9	43,5	34,5	30
	8V	50,8	49,6	44,4	39,2	32,9	21,7	16,7	54,0	46,0	37,0	31
	9V	53,8	52,6	47,4	42,2	35,9	24,7	19,7	57,0	49,0	40,0	34
	10V	58,8	57,6	52,4	47,2	40,9	29,7	24,7	62,0	54,0	45,0	40
	2V	37,7	32,4	22,9	17,2	8,7	12,3	18,0	39,0	28,0	19,0	16
	3V	42,8	37,5	28,0	22,3	13,8	17,4	23,1	44,1	33,0	24,0	21
	4V	46,8	41,5	32,0	26,3	17,8	21,4	27,1	48,1	37,0	28,0	25
BRE	5V	50,5	47,2	38,7	32,5	21,7	18,0	23,3	52,4	42,0	33,0	28
93/95	6V	55,5	52,2	43,7	37,5	26,7	23,0	28,3	57,4	47,0	38,0	34
EC	7V	59,5	56,2	47,7	41,5	30,7	27,0	32,3	61,4	51,0	42,0	38
	8V	60,8	59,6	54,4	49,2	42,9	31,7	26,7	64,0	56,0	47,0	42
	9V	65,8	64,6	59,4	54,2	47,9	36,7	31,7	69,0	61,0	52,0	47
	10V	69,8	68,6	63,4	58,2	51,9	40,7	35,7	73,0	65,0	56,0	51

NR values calculated considering a difference of 9 dB between sound power and sound pressure for a room of 100 m3 and a reverberation time of 0.5 sec. The db(A) data declared in the technical table of the manual was obtained from the sum of the db(A) relating to all the octave bands and not only to the central one. The value may therefore differ slightly from those deriving from the above data for purely mathematical reasons.

### 8-DIMENSIONS AND WEIGHTS

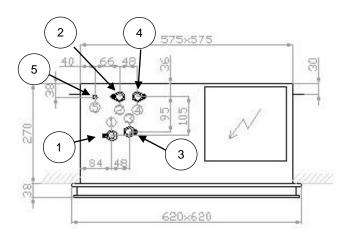

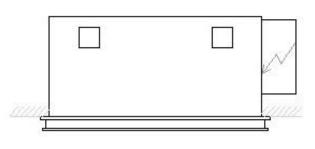

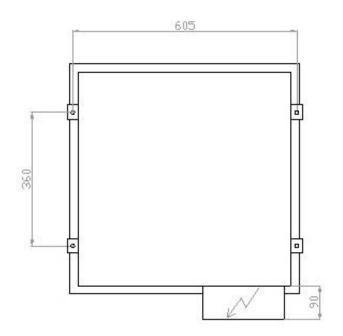

1	Main coil IN	1/2"
2	Main coil OUT	1/2"
3	Auxiliary coil IN	1/2"
4	Auxiliary coil OUT	1/2"
5	Condensate drain	d.12

		51/71	52/72/92	53/73/83/93	74 / 94	75 / 95
Unit weight	kg	27	28	30	28	30
Main coil inside volume	litres	0.6	1.3	2.0	1.4	1.4
Auxiliary coil inside volume	litres	-	-	-	0.6	0.6



#### 9-ACCESSORIES

The following accessories are available:

	HYDRAULIC ACCESSORIES	A/K/B
V22	230V 2-way ON-OFF valve	A/K
V42	2-way ON-OFF valve for 4 pipes	A/K
V23	230V 3-way ON-OFF valve	A/K
V43	230V 3-way ON-OFF valve for 4 pipes	A/K
V22M	0-10V 2-way modulating valve	A/K
V42M	0-10V 2-way modulating valve for 4 pipes	A/K
V23M	0-10V 3-way modulating valve	A/K
V43M	0-10V 3-way modulating valve for 4 pipes	A/K
ADPB	Auxiliary condensate collection tray (supplied included in the cassette)	K
PSCC-BI	Auxiliary condensate drain pump	А
	ELECTRICAL ACCESSORIES	
TR24	230Vac-24Vac, 20VA transformer for modulating valve	Α
EH	Electric heater with relay and safety thermostat	A
	AERAULIC ACCESSORIES	
FLMA	Flange for ducted air delivery	В
FLAE	Flange for outdoor air intake	В
MECO	Metal cover for exposed installation	K
	OPTIONAL FILTERS	
FA/SAN	Filter with Sanitized treatment	A
FA/H	High efficiency filter PF-ePM10 65% (only for hygienic version H)	K

**A/K/B**: A = accessory supplied mounted on the base unit; K = accessory supplied in a kit (not assembled);

B = accessory supplied assembled, but not mounted on the base unit


### 9.1-Valves (V) and auxiliary tray (ADPB)

Servo-controlled valves should be used to prevent the formation of condensate on the surface of the unit when the fan has stopped.


The valves can be supplied assembled on the unit or as kits (disassembled components).

The condensate collection tray is supplied with the unit as part of the standard equipment, without extra costs (ADPZ).

- **1.** Inlet for 2-pipe systems or cold coil (for 4-pipe system)
- 2. Outlet for 2-pipe systems or cold coil (for 4-pipe system)
- **3.** Hot/cold valve kit (2 pipes) or Cold valve kit (4 pipes)
- 4. Hot coil inlet only for 4-pipe system
- 5. Hot coil outlet only for 4-pipe system
- 6. Hot valve kit only for 4-pipe system
- 7. Auxiliary tray

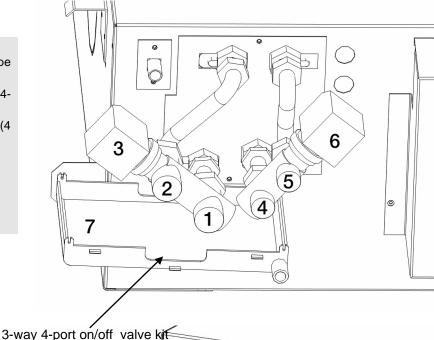

- **1.** Inlet for 2-pipe systems or cold coil (for 4-pipe system)
- **2.** Outlet for 2-pipe systems or cold coil (for 4-pipe system)
- **3.** Hot/cold valve kit (2 pipes) or Cold valve kit (4 pipes)
- 4. Hot coil inlet only for 4-pipe system
- 5. Hot coil outlet only for 4-pipe system
- 6. Hot valve kit only for 4-pipe system
- 7. Auxiliary tray

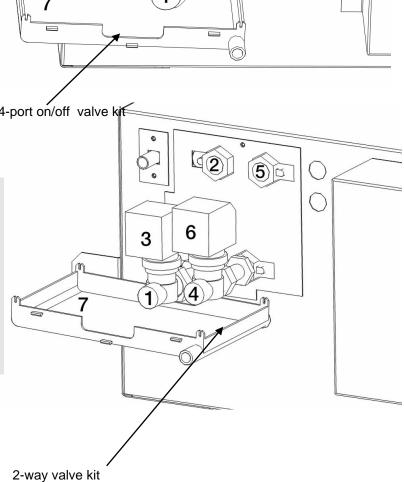



VALVES FOR MAIN COIL	51-52-53-71-72-74-75-94	73-83-92-93-95
VALVES FOR AUXILIARY COIL	74-75-94-95	
GENERAL CHARACTERISTICS	•	
Connections size	1/2"	3/4"
Kv (2-way valve)	1.7	2.5
Kv (3-way valve, direct flow)	1.7	2.5
Kv (3-way valve, by-pass)	1.2	1.6
Max differential pressure	2.0bar	1.0bar
Nominal pressure	16bar	
Water temperature	4 – 110°C	
ACTUATOR ON/OFF		
Power supply	230V-50Hz (24V-50Hz on request)	
Absorbed power	2.5W	
Stroke time	180s	
Characteristic (valve+actuator)	N.C. (NormallyClosed)	
Protection	IP44	
MODULATING ACTUATOR		
Power supply	24V-50Hz	
Absorbed power	1.5W	
Stroke time	8S	
Control signal	0-10V	
Control signal impedance	100k	
Protection	IP43	

### 9.2-Auxiliary condensate drain pump (PSCC-BI)

The auxiliary condensate drain pump is supplied assembled on the side of the cassette, next to the drain pipe. Therefore, inspection must be provided on this side, too.

Maximum water flow rate	20 l/h	
Maximum drainage height	10m (4l/h)	
Sound pressure at 1 m	28dB(A)	
Power supply	230V – 50/60Hz	
Alarm microswitch	NC 8° resistive 250V	
Circuit breaker	90°C (automatic reset)	
Protection	IP54	




### 9.3-Flange for ducted air delivery (FLMA)

It is possible to connect up to 3 ductable deliveries via d.160 collars. The available head is a function of the number of collars connected and the air flow. The positions of the collars are shown in the figure below.

### 9.4-Flange for outdoor air intake (FLAE)

It is possible to connect an outdoor air intake through a d.100 collar. The maximum outdoor air flow is 100cu.m/h. The outside air must be treated, filtered and must not be at low temperature.

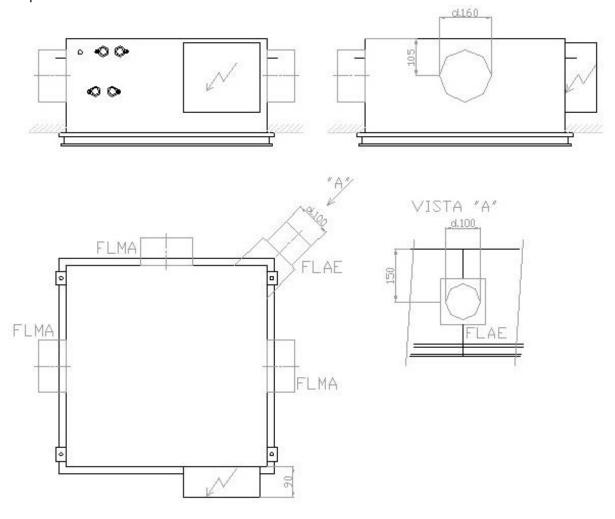




### 9.5 - Metal cover for exposed installation (MECO)

The MECO accessory allows an exposed cassette to be installed when there is no false ceiling or when the existing false ceiling height is insufficient to contain it. It is made of painted sheet metal and its installation is harmonised with the cassette and its panel. The cover on the hydraulic and electrical connections side is easily removable to facilitate maintenance of the electrical panel and valves.

Two types of installation are possible: with the hydraulic connections coming from above (vertical) or coming from the side (horizontal) just below the ceiling. With horizontal connections, special pre-cuts are provided for the entry of the pipes inside the cover. With horizontal connections, special pre-cuts are provided for the entry of the pipes inside the metal roof. If valves are also ordered, specific kits must be ordered, optimised to facilitate installation, which, for horizontal versions, include flexible hoses and manual ball valves.


#### Coil connections

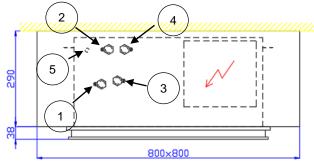



1	Main coil IN
2	Main coil OUT
3	Auxiliary coil IN
4	Auxiliary coil OUT
5	Condensate drain (d. 12)


3-way valve connections 4 on-off ports (vertical)

2-way valve connections (vertical)










3-way valve connections 4 on-off ports (horizontal)

2-way valve connections (horizontal)

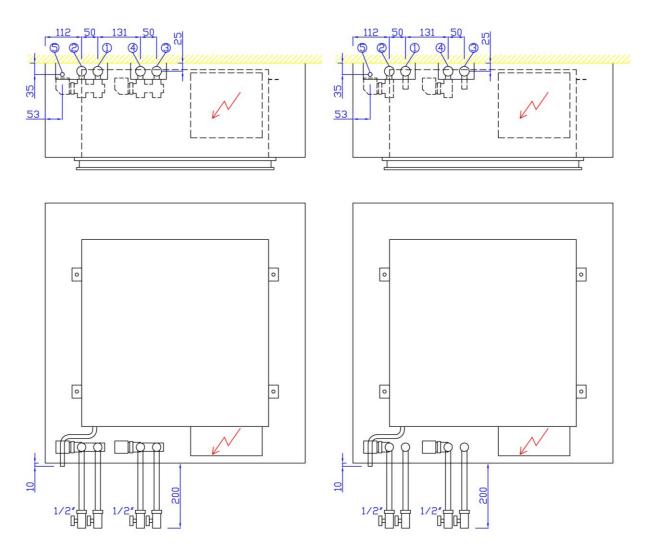

COVER CODE	DESCRIPTION	VALVE KIT CODE (*)
MECO-BRE51/95S 131	For horizontal connections - 2	Valve code + "BRE51/93S 81"
	pipes	
	For horizontal connections - 4	Valve code + "BRE74/95S 81"
	pipes	
	For vertical connections - 2/4	Valve code + "BRE51/93S 26" for 2 pipes
	pipes	Valve code + "BRE74/95S 26" for 4 pipes

<sup>(\*)</sup> ON/OFF valves (for 2 and 4 pipes) or modulating valves (only for 2 pipes) can be installed inside the MECO. It is not possible to install modulating valves for 4 pipes.



### 9.6-Filter with Sanitized treatment (FA/SAN)

Filter in synthetic material with support in galvanised steel and double galvanised mesh, thickness 6mm. The special FiltraSan treatment, developed in collaboration with Sanitized, certifies the non-proliferation of mould and bacteria:

- Staphylococcus aureus reduction: >99,99% according to JIS L 1902
- fungal growth rate: none according to EN ISO 846

The complete test reports and certifications can be obtained from our Sales department.

### 9.7-High efficiency filter (FA/H)

Filter in synthetic material, total thickness 130mm and class PF-ePM10 65%. Given its considerable size, it can be installed only in the hygienic version cassette (H). The pressure drop due to the high filtration class results in a decrease in the cassette efficiency by about 10% (with clean filter) compared to its rated performance. We also recommend using the standard filter as a pre-filter, otherwise the FA/H filter could clog very quickly.

#### 9.8-Electrical heater (EH)

Armoured electrical heater, inserted inside the coil pack, available with 3-row, 2 pipe coils. The heater must be factory-installed, it cannot be ordered as an extra accessory to be retrofitted. The heater control relay and two safety thermostats are included (one manual resetting and one automatic resetting types). The presence of the electric heater inside the coil implies a decrease of about 5% of the rated cooling capacity.

	53	73-83-93
Heater power (W)	1500	3000W
Power supply	230V-1ph-50Hz	


### 10-Hygienic version

The hygienic version differs from the standard version due to the absence of the condensate drain pump. Draining is achieved by gravity, so in order to have the required difference in height, the overall height of the cassette is greater.

This version is recommended in environments characterised by:

- Less frequent maintenance (banks, police offices, ...): services due to pump or pump float faults are no longer required
- Increased hygiene requirements (hospitals, health care facilities ...): water stagnation inside the tank is reduced, consequently, the chances of bacteria or mould growth are reduced.
- Silent environment requirements (libraries, ...): the (however limited) condensate drain pump operating noise is eliminated.


For a better level of hygiene, we recommend using the optional FA/SAN and/or FA/H filter cassette (see the specific paragraph)

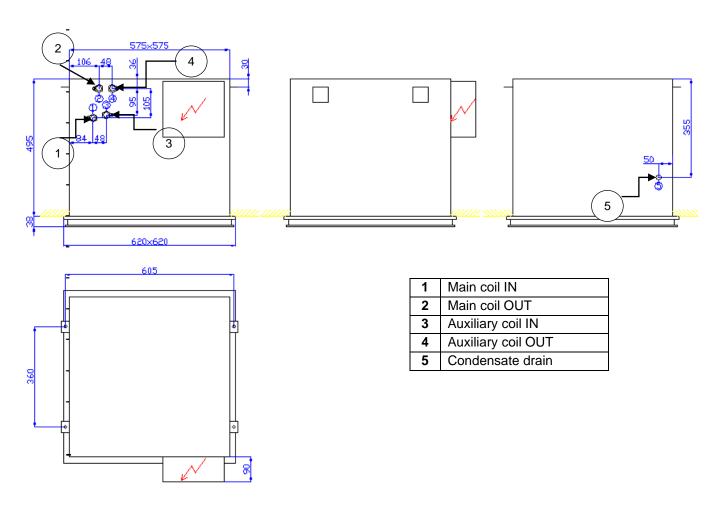




#### 11-Electrical connections

### 11.1-Wiring diagram of cassette with AC motor

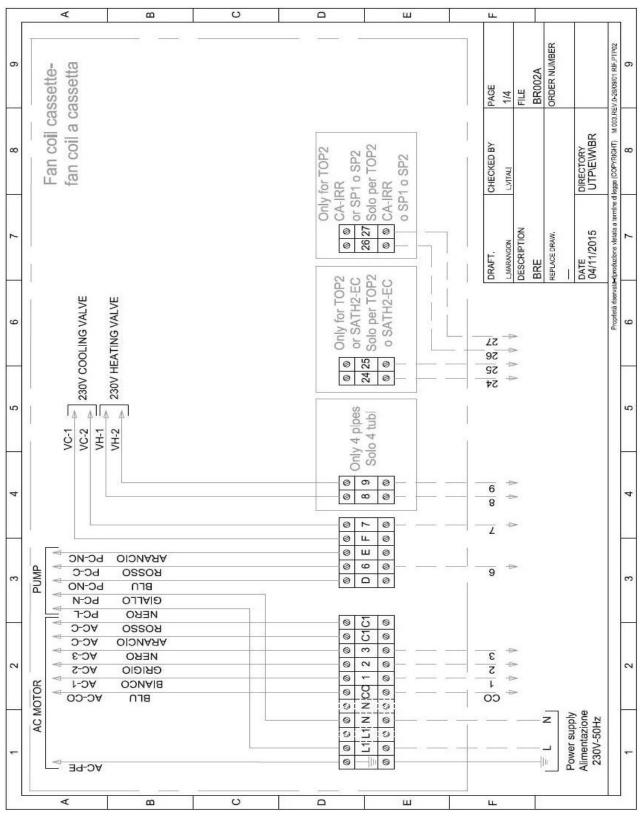

### 11.2-Wiring diagram of cassette with EC motor

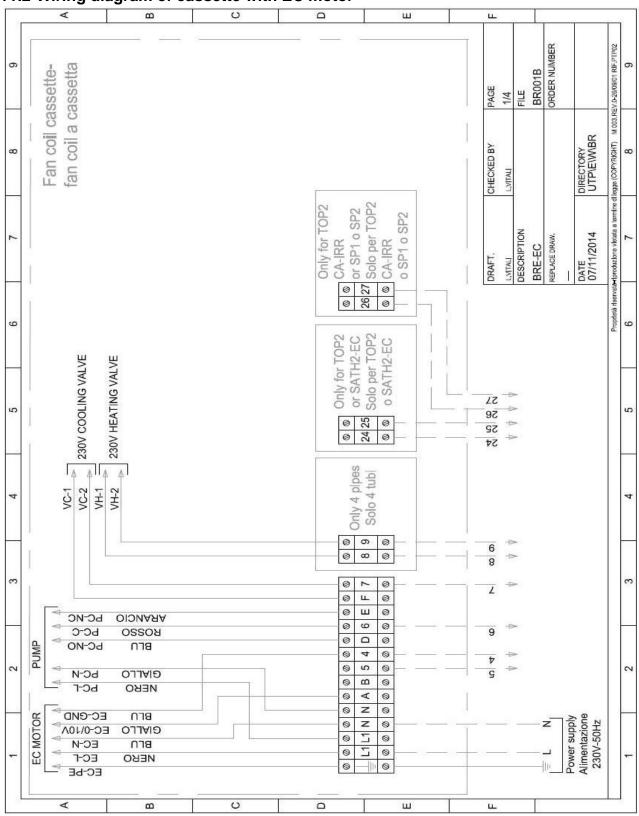



FXTFR	NAL THERMOSTAT CONTROLS
CO	Fan common wire (neutral)
1	Minimum fan speed (line)
2	Medium fan speed (line)
3	Maximum fan speed (line)
4	Reference for 0-10V signal
5	0-10V signal for motor control
6	Common 2-pipe valve / 4-pipe cold valve (neutral)
7	2-pipe valve signal / 4-pipe cold valve (line)
8	Common 4-pipe hot valve (neutral) - only if available
9	4-pipe hot valve signal (line) - only if available
24-25	NTC water probe - only if available
26-27	NTC remote air probe - only if available
	NOTES:
-	

Aertesi srl reserves the right to introduce any changes considered necessary to improve the product by editing the related technical data at any time.





### something different

### Aertesi srl

viale della tecnica, 6/a 35026 Conselve (PD) ITALY

t. +39.049.9501109 f. +39.049.9500823

www.aertesi.com info@aertesi.com